Завантажено з e27.com.ua

COMO 371

220-240V 50-60Hz | IP 54 | E27

Como 371XX0309
23.07.2021 v.09.7
www.norlys.com

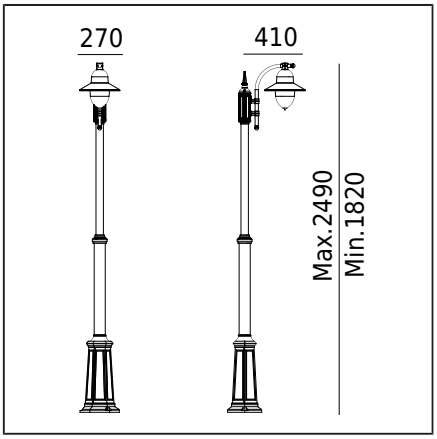

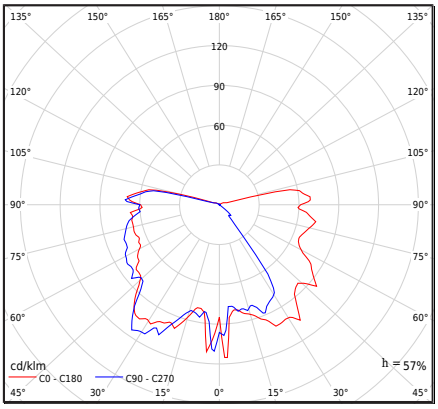

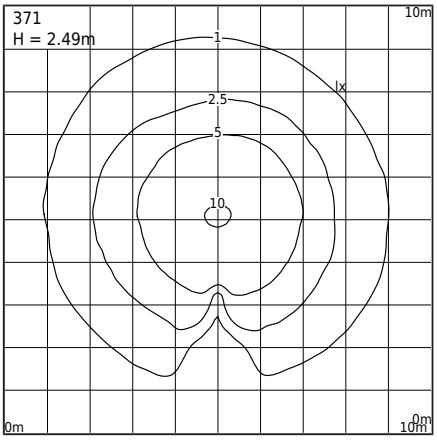

Type of luminaire

Type of lumianire	Pole luminaire.
Photometric body	Uncovered light.
Characteristics of the luminaire	Classic design luminaire, mounted on a telescopic lighting pole. Adjustable height 1820..2490mm. For lighting gardens, terraces and other architectural concepts.

General information

Materials	Powder painted aluminum cast. Lens - clear polycarbonate, UV stabilized. Silicone gasket.
Mounting method	Fixing of the luminaire: 3 holes ø10,5mm, on a daimeter ø240mm every 120°. Set contains: Art. 3030 - luminaire, Art. 3040 - reduction, Art. 3010 - lightning pole. Other accessories need to be purchased separately.
Terminal	Connection terminal: max. 4x2,5mm², possibility to connect luminaire in loop max 4x2,5mm². A round wire in the isolation with a diameter of max ø6...12,5mm.
Type of light source	E27 lamp
Net / gross weight of luminaire	9,17kg / 11,71kg

Technical data

E27 lamp	QA55 / LED A55..60
Light source wattage	MAX 57W / LED 9W
Ta Rated temperature	+25°C

This product contains light source of energy efficiency class A+ D

Possibility to order the luminaire with LED E27 Philips Master LEDbulb 806lm / 8,5W / 2700K (dimmable).

Accessories sold separately

108GA0009	Anchoring support.
305ZX0009	Concreting anchor.
306ZX0009	Ground anchor.
46999021	LED E27 lamp.

Recommended light sources

Osram ECO PRO Classic 57<=>75W E27	Philips ECO Classic 53<=>75W E27
Osram LED Parathom Classic / Retrofit E27	Philips Master LEDbulb / Classic / CorePro E27

Spare parts

06370797	Lens.

Files to download

Photometric LDT files	Photometric IES files
Manual	

Indexes

Index	Color	RAL
371B	BLACK	9005
371W	WHITE	9003

Norlys AS
P.B 1014 Hoff, 0218 Oslo
Hovfaret 4B, 0275 Oslo
Norway
+47 24 12 40 11
firmapost@norlys.no

TÜVRheinland CERTIFIED Management System ISO 9001:2015 IATF 16949:2016 www.tuv.com ID 9108651873
PCC Cert CERTIFICATE ISO 14001
RoHS 2011/65/UE

Please read the manual before installing. Due to the dynamic development of lighting technology, additional information is available upon request. LED module must be replaced by a qualified person in accordance with applicable regulations. Condensation, which can occur in luminaires, is a natural phenomenon and does not impair the quality of the luminaire.